

**Public Service Company of New Mexico
Person Generating Station
Groundwater Treatment System**

**Treatment Effectiveness Report
First Quarter 2000**

May 10, 2000

Report Prepared Pursuant to Requirements Contained in:

**The Person Generating Station Corrective Action Directive (NMT 360010342)
and
The New Mexico Environment Department Discharge Plan, DP-1006**

Executive Summary

Contour maps of the three primary contaminants of concern, PCE, DCE, and TCA, are shown in Figures 10, 11, and 12, respectively. These contour maps indicate the areal extent of the groundwater plume and the associated contaminant concentrations within the plume. The contour maps are prepared twice per year using data from the spring and fall sampling events.

Figure 10 indicates that the areal extent of the PCE plume has decreased since October 1999. Figure 11 and Figure 12 indicate a similar trend in plume size reduction.

In an effort to enhance the overall treatment system effectiveness by increasing system pumping rates, two new extraction wells were completed during the last quarter. Both wells have been operational during this quarter.

I. Introduction

This report is prepared pursuant to requirements contained in the Person Generating Station Corrective Action Directive (NMT360010342) issued by the New Mexico Environment Department (NMED) Hazardous and Radioactive Materials Bureau, and requirements contained in Discharge Plan DP-1006 issued by the NMED Groundwater Protection and Remediation Bureau.

This report contains information on sampling results and operational activities at the Person Generating Station Groundwater Treatment System (GTS). The GTS is designed to extract volatile organic compound (VOC) contaminated groundwater, treat through an air stripper and granular activated carbon filter, and discharge the treated water to an irrigation pond at the UNM Championship Golf Course.

Figure 1 is a site map of the Person Generating Station vicinity and shows well locations and the location of the pipeline system. Note that Figure 1 does not show the locations of the recently installed extraction wells, EW-2 and EW-3.

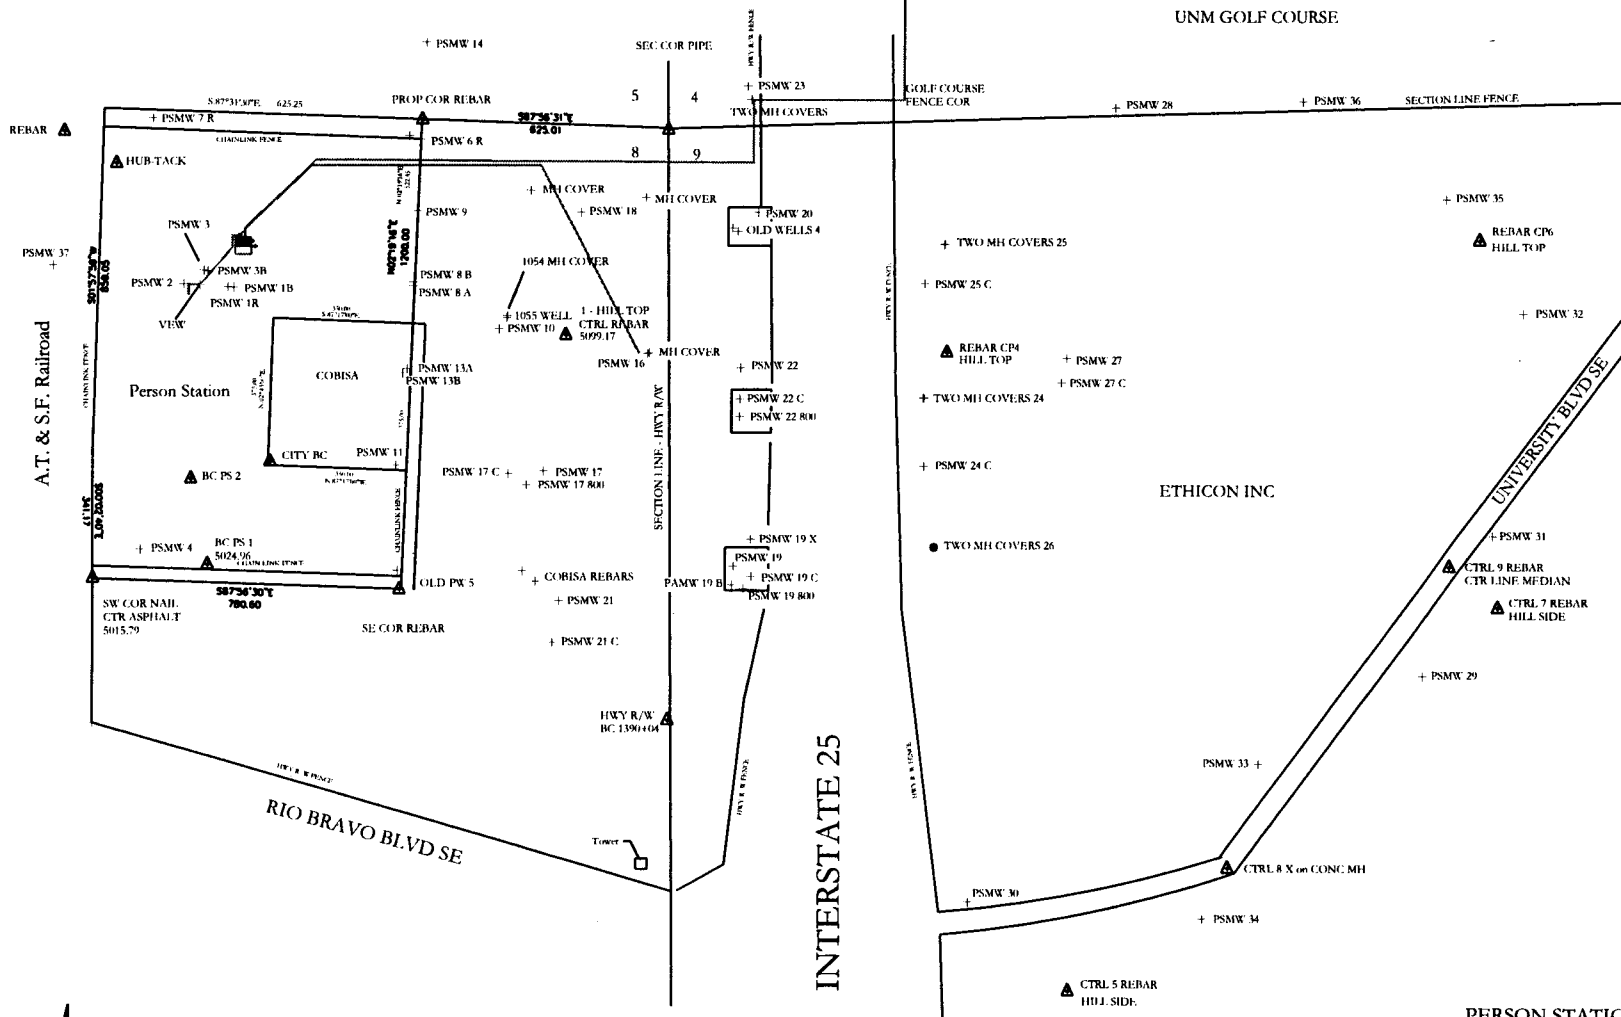


Exhibit A

1" = 500'

PERSON STATION MONITOR WELLS
 at Person Station and Ethicon
 WITHIN SEC. 8 & 9, T.9 N., R.3 E., N.M.P.M.
 BERNALILLO COUNTY, NEW MEXICO
 PUBLIC SERVICE CO. OF NEW MEXICO
 ALBUQUERQUE, NEW MEXICO
 DWN BY: J.P.C. DATE: OCTOBER 11, 1999
 OKD BY: SCALE SHOWN
 Modified by J. Evaskovich 2/4/00

II. Operational History

The GTS was started on Friday, January 27, 1995, with treated effluent being sent to the UNM Championship Golf Course.

During 1995, the GTS encountered periodic minor problems as well as a more serious problem with mineralization of the system components downstream from the air stripper. The GTS was kept off-line for most of the first quarter of 1996 while the mineralization problem was studied. After evaluation of various treatment methods, an acid treatment system was selected as the most feasible solution to the mineralization problem.

Installation of the acid treatment system began in early May 1996. In early April, construction activities were initiated to convert monitor wells PSMW-24, PSMW-25, and PSMW-26 (PSMW-24, 25, and 26) to extraction wells. The GTS resumed regular operation in mid-June 1996.

The Person Generating Station Discharge Plan, DP-1006, was amended and approved by the Groundwater Protection and Remediation Bureau in mid-June 1997. As part of the amended plan, the existing plan requirement for the sulfuric acid treatment system was replaced. Previously, acid addition to the effluent was restricted to 35 mg/l. The new requirement specifies adjustment of the acid treatment system to maintain an effluent pH range of 6.0 to 9.0. A pH probe and chart recorder were installed on the effluent discharge tank for daily monitoring of pH, and effluent samples are collected monthly for total sulfate analysis.

In an effort to enhance the GTS effectiveness by increasing system pumping rates, two new extraction wells were completed during October 1999. The new wells are designated EW-2 and EW-3. EW-2 is located approximately 34 feet north of PSMW-10. EW-3 is located approximately 39 feet north of PSMW-22. Both extraction wells have been operational during this quarter.

III. Groundwater Treatment Effectiveness

Figures 2, 3, and 4 show graphs of concentration of total chlorinated VOCs as measured at wells PSMW-16, VEW, and EW-1 over the operational period of the GTS. Figure 5 shows a graph of concentration of total chlorinated VOCs in the combined influent from wells PSMW-24, 25, and 26 over the operational period of these wells. Figures 6 and 7 show graphs of concentration of total chlorinated VOCs over the operational period of these wells. More detailed data for these wells are shown in Tables 1, 2, 3, 4, 5, and 6.

At PSMW-16 and in the combined influent from PSMW-24, 25, and 26, a decrease followed by a rebound effect was observed this quarter. This may be the result of intermittent operation of PSMW-16 and PSMW-24 this quarter due to operational difficulties with the pump.

At the VEW, EW-2, and EW-3, total chlorinated VOCs fluctuated during the first quarter. At EW-1, total chlorinated VOCs increased slightly during this quarter.

Laboratory reports for this quarter are contained in Appendix A.

Figure 2
Total VOCs at PSMW-16

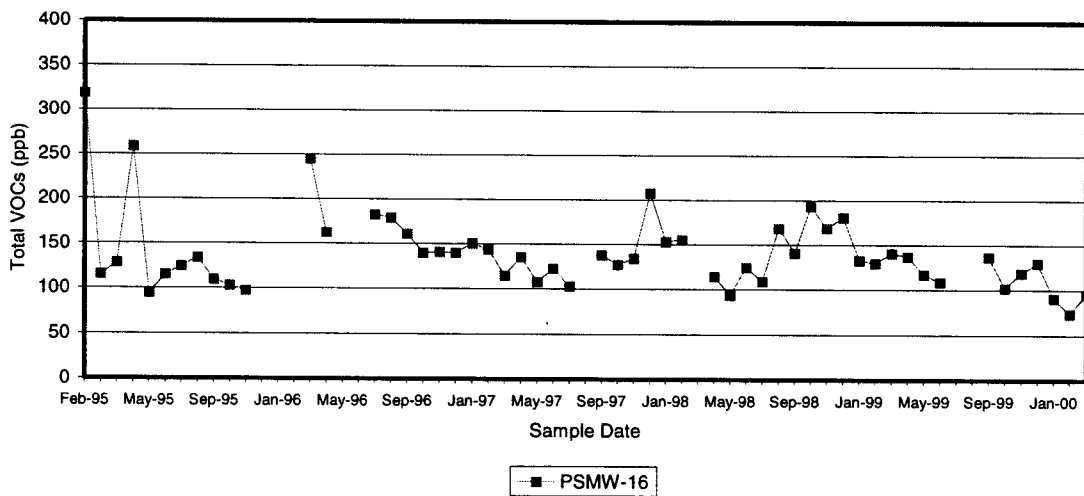


Figure 3
Total VOCs at VEW

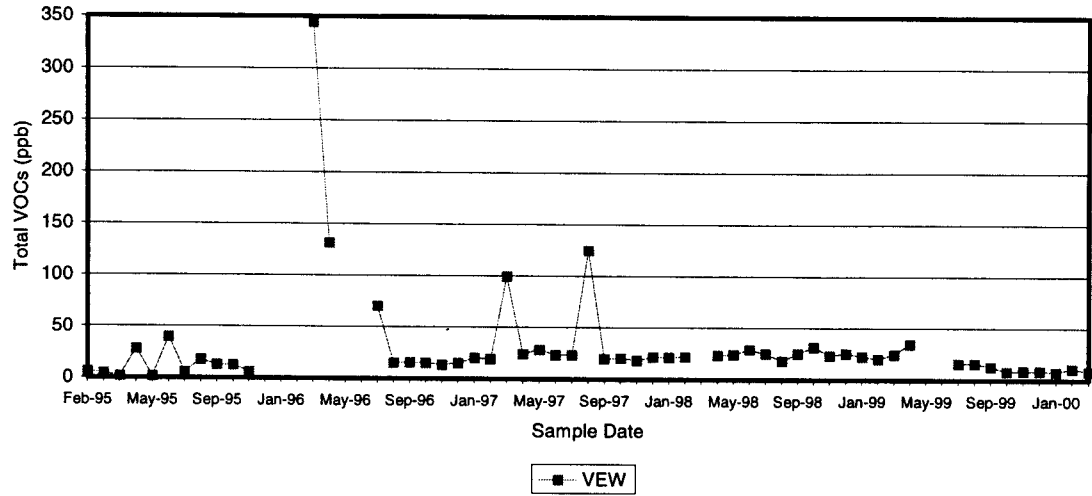


Figure 4
Total VOCs at EW-1

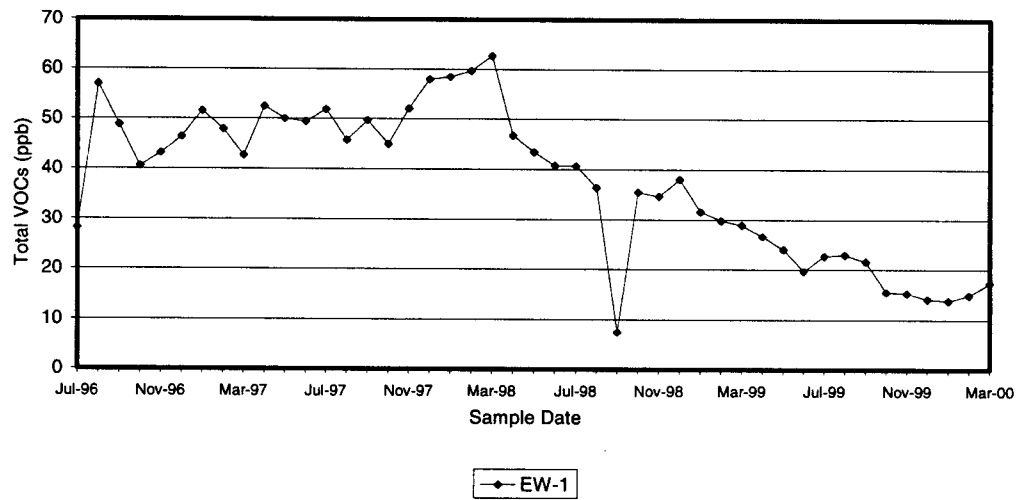


Figure 5
Total VOCs at PSMW-24,25,26

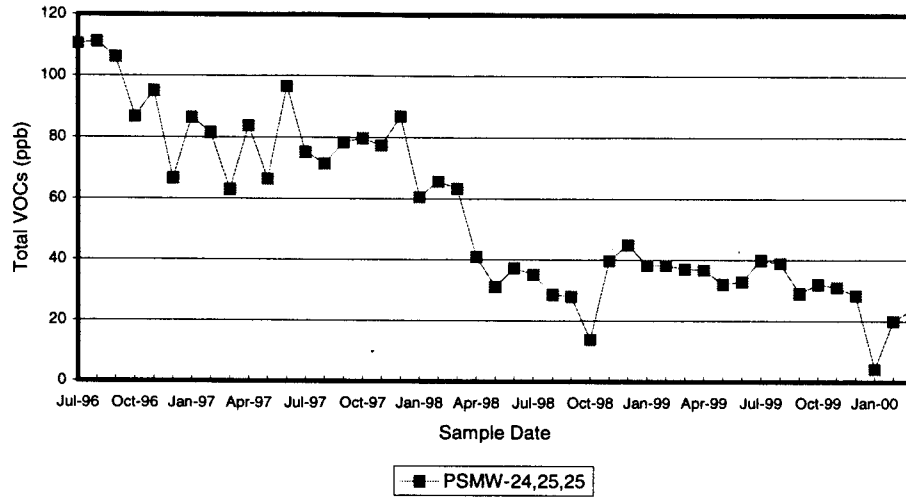


Figure 6
Total VOCs at EW-3

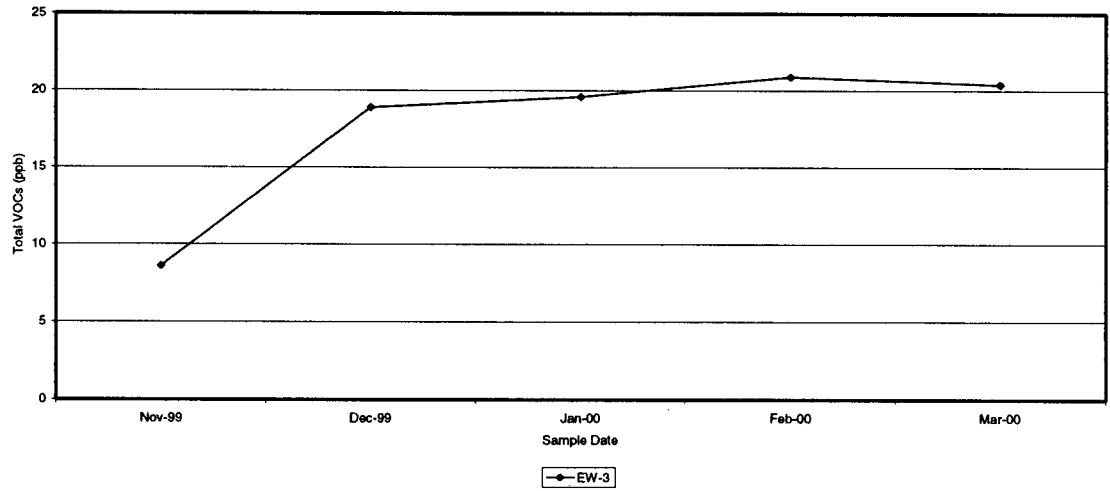


Figure 7
Total VOCs at EW-2

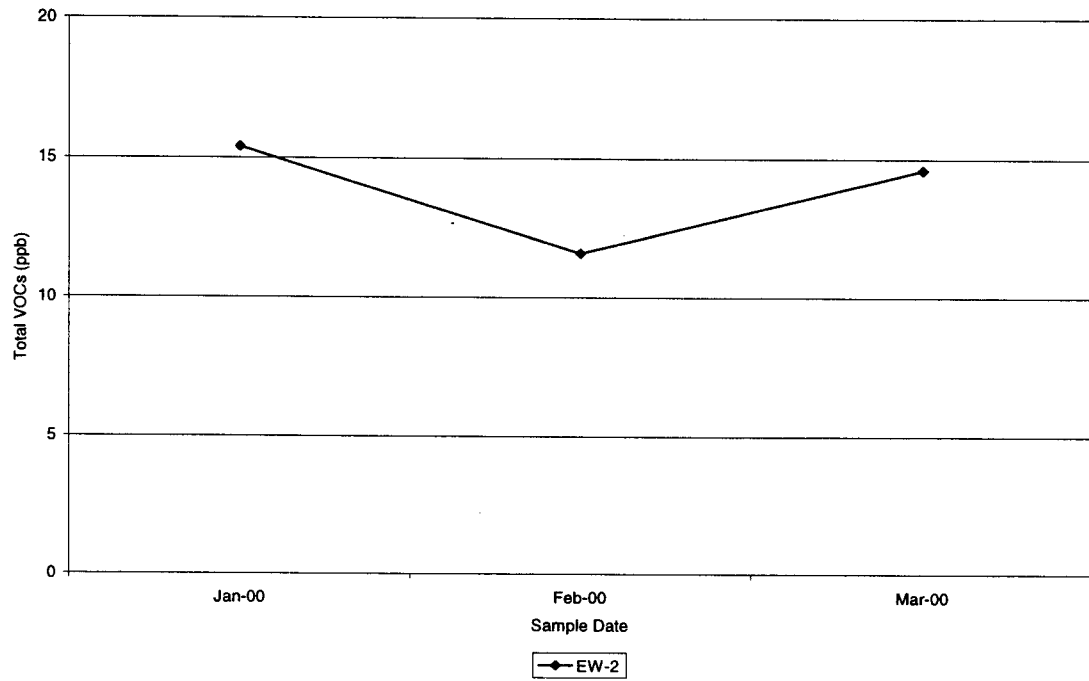


Table 1
Influent Concentrations at PSMW-16

Date	Laboratory Report No.	PCE (ppb)	DCE (ppb)	Total VOCs (ppb)
2/1/95	502304	200	110	318.4
2/15/95	502376	69	39	115.0
3/8/95	503317	78	46	128.3
4/10/95	504341	170	81	258.6
5/18/95	505371	62	30	94.6
6/21/95	506396	76	36	114.8
7/12/95	507327	75	41	124.3
8/17/95	508405	83	45	134.0
9/13/95	509339	69	35	109.2
10/11/95	510335	66	32	102.8
11/22/95	511367	58	35	97.5
3/20/96	603347	180	63	245.3
4/17/96	604367	110	46	162.5
7/18/96	607334	120	54	182.9
8/15/96	608331	120	51	179.1
9/18/96	609338	110	43	160.9
10/16/96	610361	97	37	140.0
11/19/96	611331	94	42	141.0
12/17/96	612331	96	39	140.0
1/16/97	701336	99	46	150.7
2/13/97	702332	100	40	143.7
3/19/97	703344	88	23	114.6
4/17/97	704355	93	38	135.8
5/15/97	705347	71	32	107.6
6/18/97	706353	83	36	122.6
7/23/97	707360	67	34	103.1
9/15/97	709332	100	34	137.9
10/15/97	710358	92	31	127.2
11/19/97	711335	95	34	134.5
12/16/97	712318	140	68	208
1/15/98	801334	110	37	153.1
2/11/98	802336	110	38	155.3
NS	-	-	-	-
4/8/98	804337	78	30	114.4
5/20/98	805379	67	23	93.4
6/16/98	806353	89	30	124.6
7/1/98	807300	76	29	108.8
8/13/98	808040	120	41	168.5
9/16/98	809042	110	26	140.7
10/7/98	810021	120	68	193.4
11/17/98	811049	100	64	169
12/9/98	812045	110	66	180.7
1/7/99	901010	100	28	132.8
2/4/99	902014	100	26	129.3
3/3/99	903010	100	36	140.5
4/21/99	904091	100	32	137.0
5/14/99	905048	87	25	116.7
6/9/99	906040	79	25	108.3
NS	-	-	-	-
NS	-	-	-	-
9/2/99	909005	99	32	136.8
10/11/99	910036	75	23	102
11/10/99	911035	80	33	118.6
12/8/99	912027	87	36	129.5
1/12/00	001021	64	20	90.5
2/10/00	002042	54	13	73.6
3/7/00	003023	62	26	95.1

NS: Not Sampled

Table 2
Influent Concentrations at VEW

Date	Laboratory Report No.	PCE (ppb)	DCE (ppb)	Total VOCs (ppb)
2/1/95	502304	5.3	0.8	6.1
2/15/95	502376	4	0.5	4.5
3/8/95	503317	1.5	0.3	1.8
4/10/95	504341	21	5.8	28.1
5/18/95	505371	1.4	<0.2	1.4
6/21/95	506396	25	9.4	39.8
7/12/95	507327	3.5	1.0	5.8
8/17/95	508405	6.4	1.1	17.7
9/13/95	509405	9.7	1.9	12.9
10/11/95	510335	9.3	1.8	12.5
11/22/95	511367	4.6	1.1	6.0
3/20/96	603347	270	72	344.3
4/17/96	604367	94	24	131.2
7/18/96	607334	47	14	70.6
8/15/96	608331	5.0	2.1	15.2
9/18/96	609338	3.1	2.1	15.8
10/16/96	610361	3.2	2.1	15.3
11/19/96	611331	0.8	1.8	13.6
12/17/96	612331	<0.5	2.0	15.0
1/16/97	701336	0.9	3.2	20.2
2/13/97	702332	1.0	2.4	19.2
3/19/97	703344	68	17	99.5
4/17/97	704355	2.8	3.4	24.4
5/15/97	705347	6.1	5.3	28.5
6/18/97	706353	3.8	4.2	23.5
7/23/97	707360	2.9	4.0	23.6
8/13/97	708339	57	50	124.8
9/15/97	709332	1.7	3.4	19.8
10/15/97	710358	3.2	3.1	20.5
11/19/97	711335	1.3	3.2	18.7
12/16/97	712318	1	4.8	21.7
1/15/98	801334	2.5	3.6	21.3
2/11/98	802336	2.9	3.7	22
NS	-	-	-	-
4/8/98	804337	6.4	5.0	23.7
5/20/98	805379	8.4	5.4	24.3
6/16/98	806353	11	6.2	29.1
7/1/98	807300	7.6	4.6	25.0
8/13/98	808040	5.6	3.8	18.2
9/16/98	809042	8.9	5.6	25.3
10/7/98	810021	10	9.4	31.7
11/17/98	811049	6.9	5.2	23.7
12/9/98	812045	7.9	5.6	25.4
1/7/99	901010	7.7	4.3	22.5
2/4/99	902014	7.0	4.0	20.0
3/3/99	903010	7.9	6.2	24.7
4/21/99	904091	17.0	8.9	34.8
NS	-	-	-	-
NS	-	-	-	-
7/6/99	907015	5.5	3.0	16.3
8/5/99	908021	5.4	3.2	16.3
9/2/99	909005	2.5	2.6	13.0
10/11/99	910036	0.7	0.9	8.3
11/10/99	911035	< 0.5	1	8.7
12/8/99	912027	0.8	1.1	8.8
1/12/00	001021	0.9	1.1	7.6
2/10/00	002042	3.7	1.3	11.1
3/7/00	003023	1.1	1.3	8.3

NS: Not Sampled

Table 3
Influent Concentrations at EW-1

Date	Laboratory Report No.	PCE (ppb)	DCE(ppb)	Total VOCs (ppb)
8/17/95	508405	3.5	0.9	5.4
9/13/95	509339	25	6.1	33.6
10/11/95	510335	49	8.8	61.4
11/22/95	511367	38	9.5	51.3
7/18/96	607334	20	5.7	28.2
8/15/96	608331	45	8.4	57.0
9/18/96	609338	37	7.8	48.8
10/16/96	610361	29	7.3	40.6
11/19/96	611331	32	7.0	43.2
12/17/96	612331	33	7.7	46.4
1/16/97	701336	36	9.2	51.6
2/13/97	702332	32	7.7	47.9
3/19/97	703344	29	5.7	42.7
4/17/97	704355	31	8.4	52.5
5/15/97	705347	27	9.7	50
6/18/97	706353	23	8.6	49.4
7/23/97	707360	25	9.5	51.9
8/13/97	708339	20	6.8	45.8
9/15/97	709332	21	8.5	49.7
10/15/97	710358	18	6.5	45
11/19/97	711335	20	9.7	52.1
12/16/97	712318	21	12	58
1/15/98	801334	20	11	58.5
2/11/98	802336	21	11	59.7
3/11/98	803324	20	16	62.7
4/8/98	804337	16	9.7	46.8
5/20/98	805379	16	9	43.5
6/16/98	806353	13	7.9	40.8
7/1/98	807300	12	7.7	40.7
8/13/98	808040	8.5	7	36.4
9/16/98	809042	3.2	2.7	7.4
10/7/98	810021	9.5	7.7	35.5
11/17/98	811049	10	7.5	34.6
12/9/98	812045	12	8.4	38.1
1/7/99	901010	10	5.8	31.6
2/4/99	902014	10	5.7	29.8
3/3/99	903010	8.2	6.9	28.9
4/21/99	904091	8.3	5.5	26.6
5/14/99	905048	7.1	4.6	24.1
6/9/99	906040	5.5	3.5	19.7
7/6/99	907015	6.1	4.1	22.7
8/5/99	908021	6.2	4.3	23.0
9/2/99	909005	5.5	4.6	21.6
10/11/99	910036	5	2.3	15.5
11/10/99	911035	4	2.4	15.3
12/8/99	912027	3.7	2.5	14.1
1/12/00	001021	4.7	2.5	13.8
2/10/00	002042	4.3	3.2	14.9
3/7/00	003023	5.2	3.2	17.3

NS: Not Sampled

Table 4
 Combined Influent Concentrations at PSMW-24, 25, and 26

Date	Laboratory Report No.	PCE (ppb)	DCE (ppb)	Total VOCs (ppb)
7/18/96	607334	49	55	110.6
8/15/96	608331	47	50	111.3
9/18/96	609338	58	44	106.3
10/16/96	610361	41	40	86.8
11/19/96	611331	46	44	95.2
12/17/96	612331	33	30	66.7
1/16/97	701336	41	41	86.5
2/13/97	702332	41	37	81.5
3/19/97	703344	37	23	63.0
4/17/97	704355	42	37	83.8
5/15/97	705347	33	30	66.4
6/18/97	706353	39	55	96.6
7/23/97	707360	37	36	75.2
8/13/97	708339	39	30	71.5
9/15/97	709332	42	34	78.4
10/15/97	710358	48	29	79.8
11/19/97	711335	41	34	77.5
12/16/97	712318	40	47	87
1/15/98	801334	33	25	60.6
2/11/98	802336	36	27	65.7
3/11/98	803324	30	31	63.4
4/8/98	804337	21	18	41
5/20/98	805379	18	12	31.1
6/16/98	806353	21	15	37.3
7/1/98	807300	18	16	35.2
8/13/98	808040	14	13	28.6
9/16/98	809042	6.5	4.4	27.9
10/7/98	810021	5	7.3	13.9
11/17/98	811049	22	17	39.7
12/9/98	812045	25	19	45
1/7/99	901010	22	15	38.2
2/4/99	902014	23	14	38.2
3/3/99	903010	20	16	37.1
4/21/99	904091	20	15	36.8
5/14/99	905048	18	14	32
6/9/99	906040	18	14	32.8
7/6/99	907015	22	18	40
8/5/99	908021	22	17	39
9/2/99	909005	17	12	29
10/11/99	910036	19	13	32
11/10/99	911035	18	13	31
12/8/99	912027	16	12	28.3
1/12/00	001021	2.7	1.5	4.2
2/10/00	002042	10	0.2	20
3/7/00	003023	13	10	23.7

NS: Not Sampled

Table 5
Influent Concentrations at EW-2

Date	Laboratory Report No.	PCE (ppb)	DCE (ppb)	Total VOCs (ppb)
1/12/00	001021	2.7	4.3	15.4
2/10/00	002042	1.5	2.7	11.6
3/7/00	003023	2.7	4.3	14.6

Table 6
Influent Concentrations at EW-3

Date	Laboratory Report No.	PCE (ppb)	DCE (ppb)	Total VOCs (ppb)
11/10/99	911035	5.1	2.9	8.6
12/8/99	912027	12	6.3	18.9
1/12/00	001021	13	5.7	19.6
2/10/00	002042	12	7.7	20.9
3/7/00	003023	12	7.3	20.4

IV. Operational Activities

Operational activities during the first quarter included maintenance repairs to the pumps and valves on EW-2, PSMW-16 and PSMW-25.

V. Influent and Effluent Flow Volumes

Flow totalizing meters are present on each influent well line and on the effluent flow line. Table 7 below details flow volumes from each influent well and the effluent line. Differences between total influent and total effluent volumes may be attributed to water loss (evaporation) out the stack in the air stripper system and to differences, inaccuracies, and operational problems with the flow meters.

**Table 7
Influent and Effluent Flow Volumes**

Source	Meter Number	Start Reading	End Reading	Volume (Gallons)
Flow Volumes for January 2000:				
Influent (VEW)	Badger Meter No. 94976130	4,312,523	4,435,802	123,279
Influent (PSMW-16)	Hayes Meter No. 29408700	6,874,591	6,994,804	120,213
Influent (EW-1)	Hayes Meter No. 29408732	6,370,928	6,521,228	150,300
Influent (EW-2)	Badger Meter No. 15796506	12,090	359,745	347,655
Influent (EW-3)	Badger Meter No. 15796517	476,552	1,884,735	1,408,183
Influent (PSMW-24)	Fisher Porter Meter No. 960307112	6,361,170	6,485,450	124,280
Influent (PSMW-25)	Fisher Porter Meter No. 960307112	2,209,630	2,264,780	55,150
Influent (PSMW-26)	Fisher Porter Meter No. 960307112	2,627,180	2,650,030	22,850
Effluent (to Golf Course)	Fisher Porter Meter No. 960307112	4,890,147	6,958,092	2,067,945
Flow Volumes February 2000:				
Influent (VEW)	Badger Meter No. 94976130	4,435,802	4,521,176	85,374
Influent (PSMW-16)	Hayes Meter No. 29408700	6,994,804	7,067,729	72,925
Influent (EW-1)	Hayes Meter No. 29408732	6,521,228	6,615,265	94,037
Influent (EW-2)	Badger Meter No. 15796506	359,745	577,328	217,583
Influent (EW-3)	Badger Meter No. 15796517	1,884,735	2,949,645	1,064,910
Influent (PSMW-24)	Fisher Porter Meter No. 960307112	6,485,450	6,583,660	98,210
Influent (PSMW-25)	Fisher Porter Meter No. 960307112	2,264,780	2,298,870	34,090
Influent (PSMW-26)	Fisher Porter Meter No. 960307112	2,650,030	2,677,320	27,290
Effluent (to Golf Course)	Fisher Porter Meter No. 960307112	6,958,092	8,593,045	1,634,953
Flow Volumes for March 2000:				
Influent (VEW)	Badger Meter No. 94976130	4,521,176	4,644,426	123,250
Influent (PSMW-16)	Hayes Meter No. 29408700	7,067,729	7,143,037	75,308
Influent (EW-1)	Hayes Meter No. 29408732	6,615,265	6,752,132	136,867
Influent (EW-2)	Badger Meter No. 15796506	577,328	831,213	253,885
Influent (EW-3)	Badger Meter No. 15796517	2,949,645	4,516,072	1,566,427
Influent (PSMW-24)	Fisher Porter Meter No. 960307112	6,583,660	6,694,760	111,100
Influent (PSMW-25)	Fisher Porter Meter No. 960307112	2,298,870	2,339,470	40,600
Influent (PSMW-26)	Fisher Porter Meter No. 960307112	2,677,320	2,709,690	32,370
Monitor Well Sample Purge				250
Effluent (to Golf Course)	Fisher Porter Meter No. 960307112	8,593,045	10,777,065	2,184,020
Quarterly Total for Influent (VEW+PSMW-16+EW-1+EW-2+EW-3+PSMW-24+PSMW-25+PSMW-26+Monitor Well Sample Purge)				6,386,386
Quarterly Total for Effluent:				5,886,918
Annual Totals				
Annual Cumulative Influent Total for 2000:				6,386,386
Annual Cumulative Effluent Total for 2000:				5,886,918

VI. Laboratory Analysis

A. Influent and Effluent Sampling for Chlorinated VOCs (8021 Analysis)

During the first quarter, influent and effluent sampling was conducted pursuant to the routine schedule outlined in DP-1006, i.e., once each month. Chlorinated VOC analysis of GTS influent and effluent (after GAC units) is shown graphically in Figures 8 and 9. More detailed data are shown in Table 8 below.

As noted in last quarters' treatment effectiveness report, the addition of EW-2 and EW-3 required the operation of both treatment trains (east and west) to handle the increased influent flow rate. Currently, the influent flow is directed equally through both treatment trains.

Laboratory analytical data reports are contained in Appendix A. Influent and effluent sampling results indicate that the GTS has consistently removed chlorinated VOC contaminants in the 20 to 200 ppb range to levels below laboratory detection limits in the effluent sent to the golf course. Laboratory analysis of the water at a point after the air stripper and before the granular activated carbon treatment also show that at these influent concentrations and a flow rate of approximately 50 gpm, the air stripper alone is capable of treating the groundwater to concentrations consistently below or near laboratory detection limits for chlorinated VOCs.

Figure 8
Total VOCs GTS Influent vs. Effluent - East

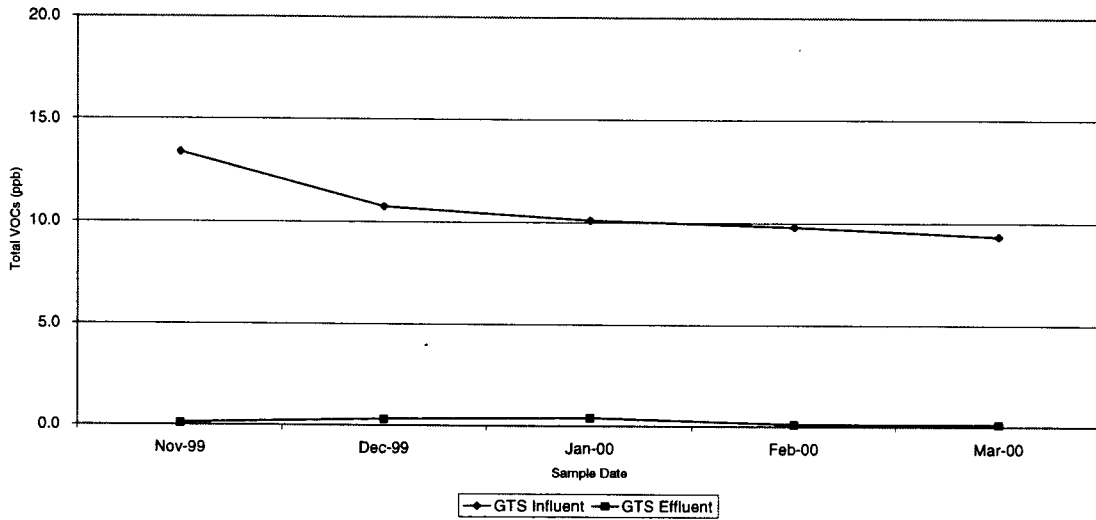


Figure 9
Total VOCs GTS Influent vs. Effluent - West

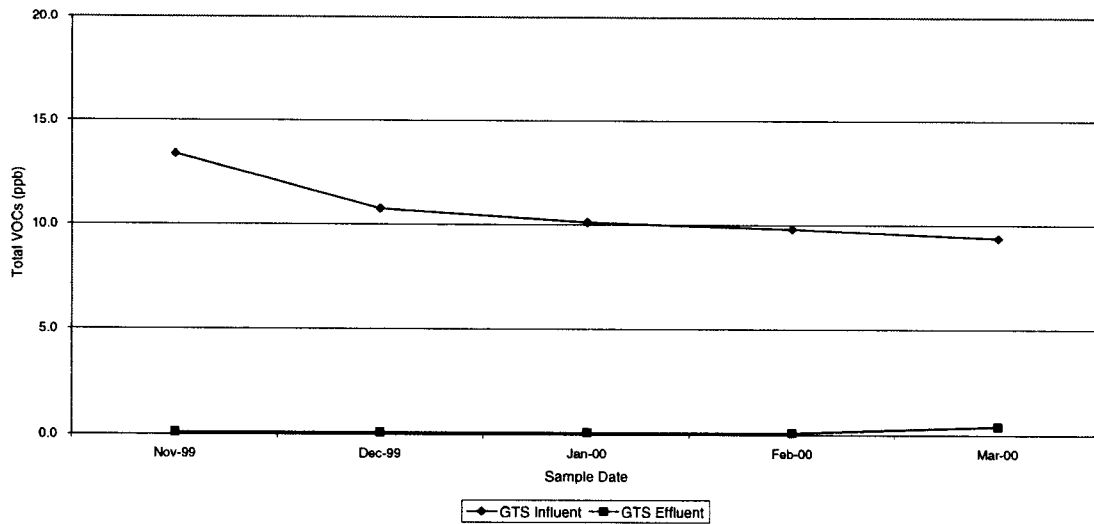


Table 8
Influent and Effluent VOC Concentrations

Sampling Date: 1/12/00		Lab Report Number: 001021			
VOC Compound	Influent (ppb)	Effluent After East Air Stripper (ppb)	Effluent After West Air Stripper (ppb)	Effluent After East GAC Unit (ppb)	Effluent After West GAC Unit (ppb)
1,1-Dichloroethane	1.9	< 0.3	< 0.3	< 0.3	< 0.3
1,1-Dichloroethene	4.3	0.5	< 0.2	0.4	< 0.2
Tetrachloroethene	14	1.7	0.8	< 0.5	< 0.5
TOTAL VOC'S	20.2	2.2	0.8	0.4	BDL

Sampling Date: 2/10/00		Lab Report Number: 002042			
VOC Compound	Influent (ppb)	Effluent After East Air Stripper (ppb)	Effluent After West Air Stripper (ppb)	Effluent After East GAC Unit (ppb)	Effluent After West GAC Unit (ppb)
1,1-Dichloroethane	2.1	0.4	0.3	< 0.3	< 0.3
1,1-Dichloroethene	6.5	0.9	0.5	< 0.2	0.3
Tetrachloroethene	11	1.7	1.1	< 0.5	< 0.5
TOTAL VOC'S	19.6	3	1.9	BDL	0.3

Sampling Date: 3/7/00		Lab Report Number: 003023			
VOC Compound	Influent (ppb)	Effluent After East Air Stripper (ppb)	Effluent After West Air Stripper (ppb)	Effluent After East GAC Unit (ppb)	Effluent After West GAC Unit (ppb)
1,1-Dichloroethane	1.9	0.4	0.3	< 0.3	< 0.3
1,1-Dichloroethene	5.8	1.2	0.6	< 0.2	0.4
Tetrachloroethene	11	2.1	1	< 0.5	< 0.5
TOTAL VOC'S	18.7	3.7	1.9	BDL	0.4

B. Effluent Sulfate Analysis and pH Monitoring

The June 1997 amendment to DP-1006 requires monthly sulfate analysis and daily pH monitoring of the GTS effluent. Table 9 presents the results of the first quarter sulfate analysis using EPA Method 375.4. The monthly minimum, maximum, and average pH readings for this quarter are shown in Table 10. The 3/00 maximum pH reading of 14 was due to recalibration of the pH probes. The monthly readings for January were unavailable at the time this report was prepared.

Table 9
GTS Effluent Sulfate Concentrations

Date	Lab Report Number	Sulfate (Mg/l)
1/12/00	001021	340
2/10/00	002042	340
3/7/00	003023	360

Table 10
Monthly pH Readings

Date	Minimum pH	Maximum pH	Average pH
1/00	N/A	N/A	N/A
2/00	6.6	7.2	7
3/00	6.1	14	7

C. Golf Course Pond Sampling

DP-1006 requires monthly sampling of the east and west ponds for 8021 (Halo) analysis during each month of operation. During the first quarter, the ponds were sampled three times pursuant to this requirement. No EPA Method 8021 (Halo) parameters were detected in the samples. Copies of the laboratory reports are contained in Appendix A.

VII. Groundwater Sampling

Under the RCRA permit, a network of groundwater monitoring wells are sampled on a twice per year schedule (normally in the spring and fall). Once sampling is complete and analytical results have been received, contour maps showing the areal extent and concentration of the contaminants in the groundwater are prepared. Contour maps for PCE, DCE, and TCA for the spring sampling event are shown in Figures 10, 11, and 12, respectively.